


BE SURE TO  
CALL KY 811  
BEFORE DIGGING

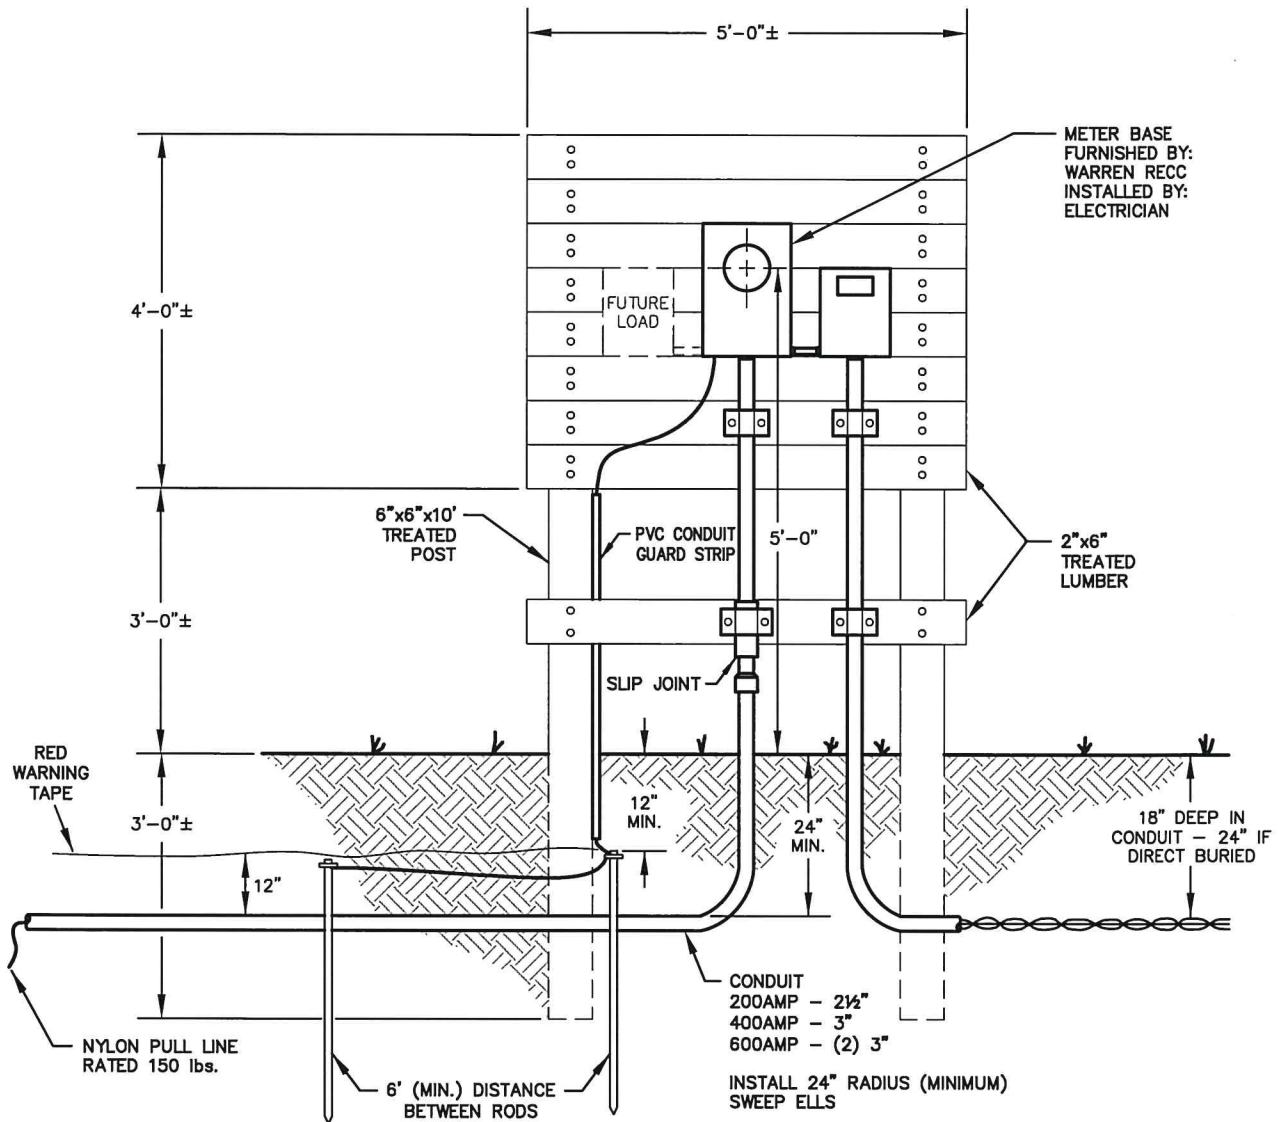

**NOTES:**

CONDUIT TO BE PVC SCHEDULE 80 ABOVE GRADE AND SCHEDULE 40 BELOW GRADE. INSTALL RED WARNING TAPE 12 INCHES ABOVE CONDUIT.

CONTINUOUS RUN OF CONDUIT LIMITED TO (3) 90° BENDS TO POLE. EXTEND CONDUIT TO WARREN RECC WOOD STAKE. IF STAKE IS ON POWER POLE, EXTEND CONDUIT 1'-0" ABOVE GROUND AND STRAP TO POLE. CAP OR CLOSE OPEN ENDS OF CONDUIT.

INSTALL SLIP JOINT SECURELY TO WOOD SUPPORT WITH PIPE STRAP.

**WarrenRECC**  
RURAL ELECTRIC COOPERATIVE CORPORATION

951 FAIRVIEW AVENUE • BOWLING GREEN, KY 42102 • 270:842-6541

Designed by  
JLL

Checked by  
TAM

DISTRIBUTION CENTER  
WITH SLIP JOINT

Approved by  
*AMC*

Drawn by  
WMB

Autocad File:  
G:\Records\Specifications\Wrecc\DIST\_CENTER2.DWG

Date  
DECEMBER, 2008

Scale  
NOT TO SCALE

Drawing Name:  
**DC-2A**

NAME: Dist\_Center2.dwg DATE: NOV 20, 2019 TIME: 9:00 AM

REV	DATE	REVISION
3	11/20/19	ADDED 811 NOTE & REVISED 320, 400 AMP TO 400, 600 AMP (EED)
1	06/31/17	CHANGED 400 AMP FROM 3.5" TO (2) 3" (CRS)
1	05/11/15	UPDATED (TAM)